


PTI INTEGRATED SYSTEMS PROPRIETARY
 THIS DOCUMENT AND THE INFORMATION DISCLOSED HEREIN ARE
 PROPRIETARY DATA OF PTI INTEGRATED SYSTEMS. NEITHER THIS
 DOCUMENT NOR THE INFORMATION CONTAINED HEREIN SHALL BE
 REPRODUCED, USED OR DISCLOSED TO OTHERS WITHOUT THE
 WRITTEN AUTHORIZATION OF PTI INTEGRATED SYSTEMS.

PT REV	DESCRIPTION	BY	DATE
-	RELEASED.	LAC	6/12/00


1 SLIDE GATE, 2 DETECTOR LOOPS

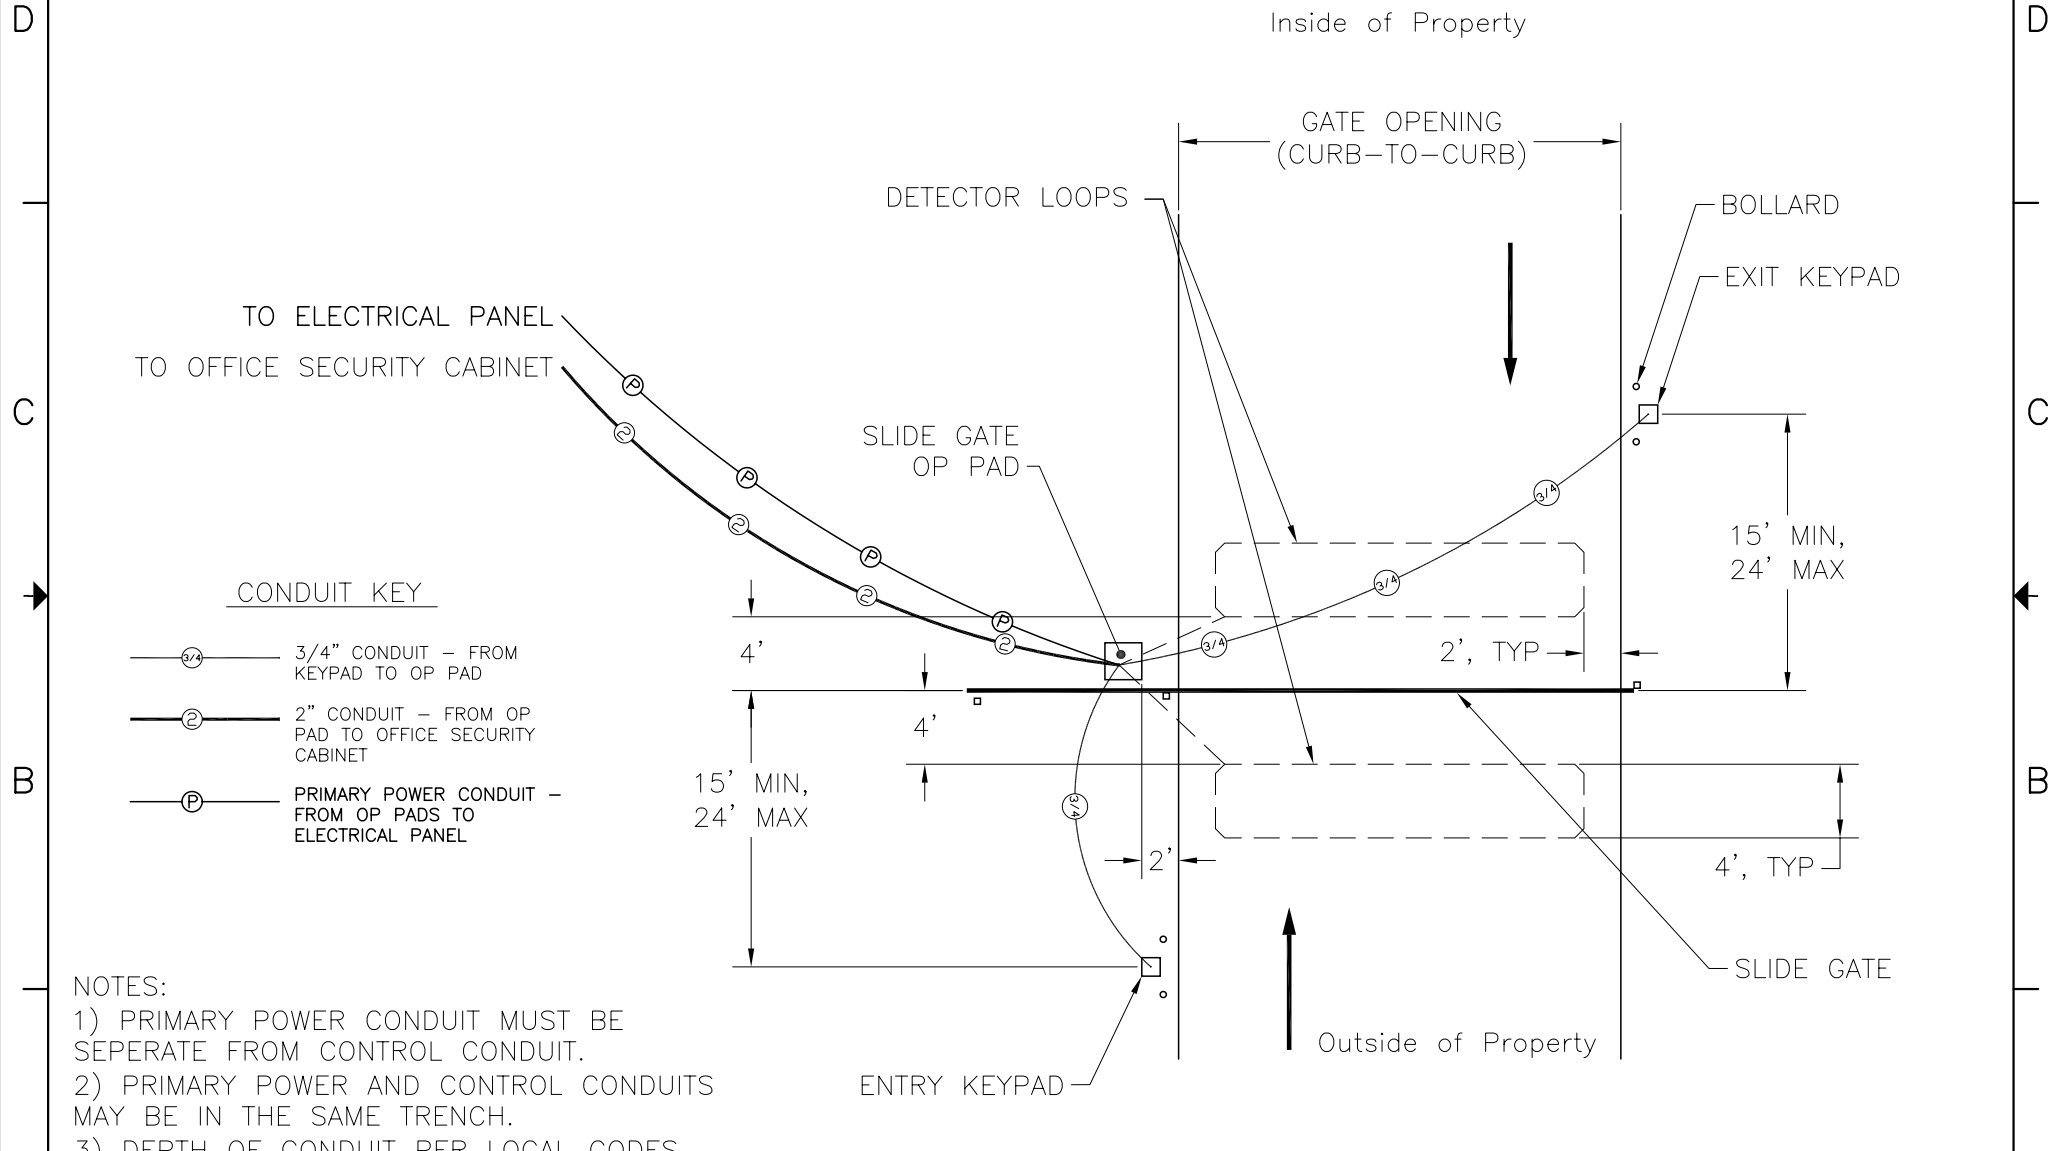

CONDUIT KEY

- ③/₄ — 3/4" CONDUIT - FROM KEYPAD TO OP PAD
- ② — 2" CONDUIT - FROM OP PAD TO OFFICE SECURITY CABINET
- Ⓟ — PRIMARY POWER CONDUIT - FROM OP PADS TO ELECTRICAL PANEL

- NOTES:
- 1) PRIMARY POWER CONDUIT MUST BE SEPERATE FROM CONTROL CONDUIT.
 - 2) PRIMARY POWER AND CONTROL CONDUITS MAY BE IN THE SAME TRENCH.
 - 3) DEPTH OF CONDUIT PER LOCAL CODES.
 - 4) DEDICATED 20 AMP CIRCUIT PER OPERATOR.



UNLESS OTHERWISE SPECIFIED
 ALL DIMENSIONS IN INCHES.
 TOLERANCE: ±
 ANGLE TOLERANCE (DEG): ±
 REMOVE BURRS & SHARP EDGES.

8271 E. Gelding Drive
 Scottsdale, AZ 85260
 Phone 480.991.1259
 FAX 480.991.1395

DRAWING DESCRIPTION		
1 SLIDE GATE, 2 DETECTOR LOOPS		
SIZE SCALE	DWG NO.	DWG REV
C/NONE		- .00
ORIG. DATE	DRAWN BY	SHEET 1 OF 1
6/12/00	L. CAMPANELLI	